





# FP-30 FOREST Control Unit for Automatic Fire Extinguishing System

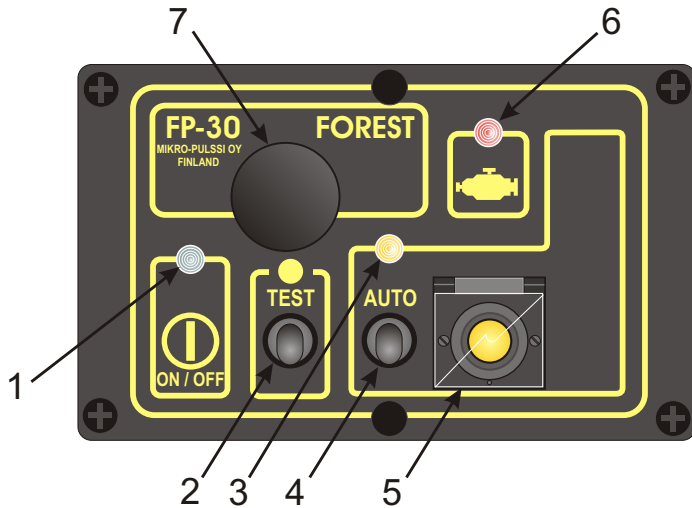

1. Light indicator (green) for power
2. Manual test and reset switch
3. Light indicator (yellow) for fault indication and indication of function mode of the system
4. AUTO-switch: choice of automatic / manual function of the system
5. Manual discharge button
6. Light indicator (red) for fire alarm and fault indication
7. Buzzer: fire alarm and fault indication

Control unit from behind

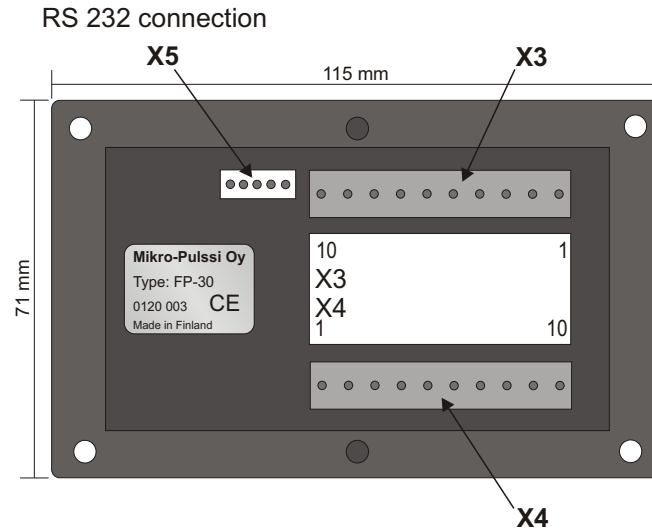

X3	
1.	Supply voltage -
2.	Supply voltage +
3.	1. discharge circuit +
4.	1. discharge circuit -
5.	1. detector circuit +
6.	Motor stop +
7.	Motor stop (OC)
8.	Voltage control
9.	Ventilator control +
10.	Ventilator control (OC)

X4	
1.	Earth
2.	Fault signal (OC)
3.	Underpressure +
4.	3. detector circuit +
5.	2. discharge circuit -
6.	2. discharge circuit +
7.	2. detector circuit +
8.	Manual discharge +
9.	External alarm (OC)
10.	External alarm +



**Mikro-Pulssi Oy**

Kaskimäenkatu 1, FIN-33900 Tampere  
 Tel.+358 3 3122 1400, Fax.+358 3 3122 1469  
 mpoy@mikro-pulssi.fi www.mikro-pulssi.fi