




FP-30 FOREST

Automatic Fire Extinguishing System

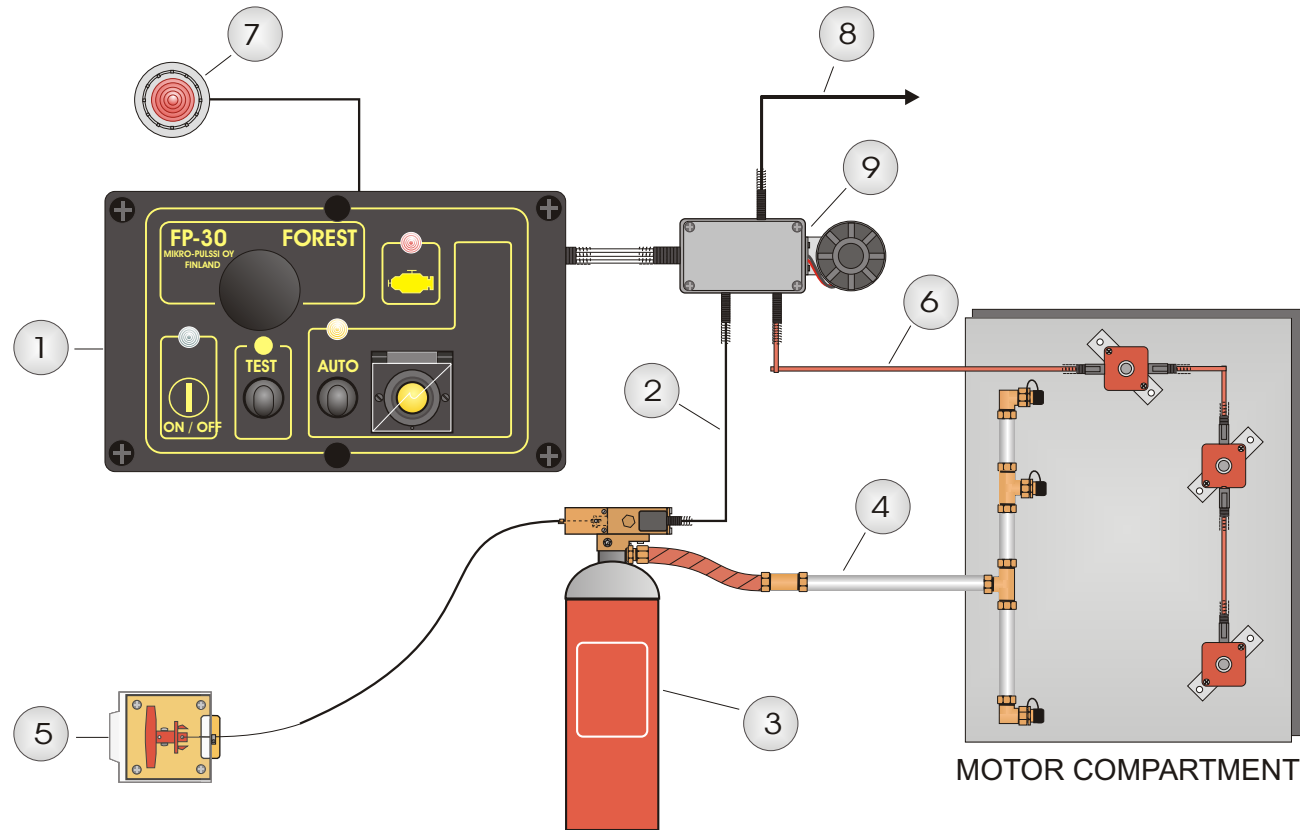

1. FP-30 Forest control unit
2. Release circuit
3. Extinguishant bottle and release valve
4. Pipes and nozzles
5. Mechanical release unit

6. Detector loop
7. Optical alarm device
8. Equipment stop outputs
9. Switch box (optional) and acoustic alarm device



Mikro-Pulssi Oy

Kaskimäenkatu 1, FIN-33900 Tampere
Tel.+358 3 3122 1400, Fax.+358 3 3122 1469
mpoy@mikro-pulssi.fi www.mikro-pulssi.fi